
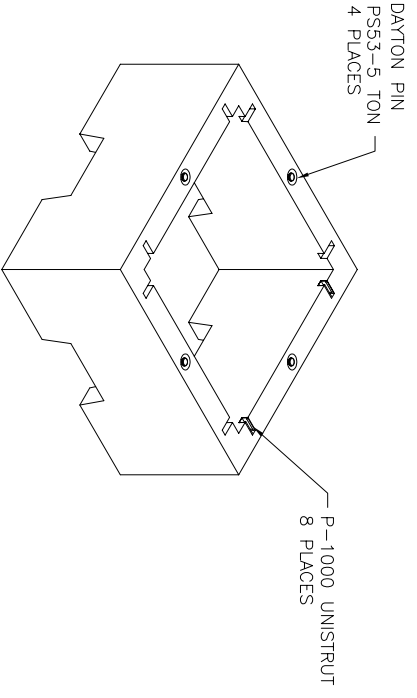
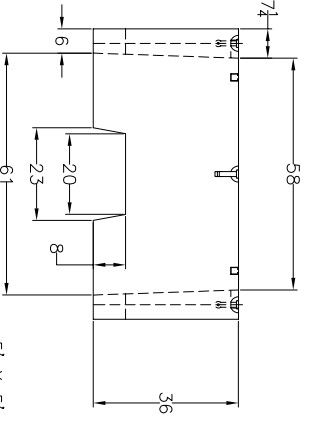



REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REVISED INTERNAL DIMENSIONS	11/04/05	

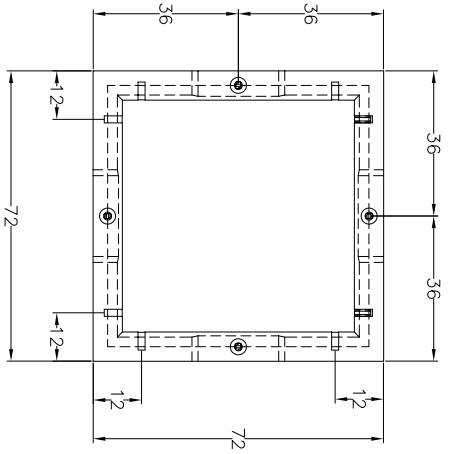

5' X 5' X 4' ID ELECTRICAL VAULT

MODEL No. EV722  
 NSE6 No. 262-722-00

Concrete 5000 psi. @ 28 days, 5-6% Air Entrainment (1.63 yds)  
 Reinforcement: #4 Rebar at 6" centers, both ways (350 LF)  
 Two P-1000 Unistruts per wall  
 One PSS35T Dayton Swift Lift Pin Centered in Each Wall  
 Estimated Weight: 4,970 Lbs



**Concrete Building Supply**  
 Quality Block, Masonry and Precast Products Since 1938

PHONE: 563-4700  
 WWW.CONCRETEBUILDINGSUPPLY.COM  
 FAX: 563-1392

ELECTRICAL VAULT EV-722  
 NSE6 No. 262-722-00

SIZE	DRAWN BY:	DWG NO.	REV
B	DAVE B.		A

SCALE 1/32"=1"  
 DATE: 5/11/05  
 SHEET 1 OF 1